



IPS TESTING

Test Report
January 5, 2022
Page 1 of 6
SGS-IPS 02235-21

Report to: Loyal Dodd
Basecrete Technologies LLC
7969 Moyer Ave
Sarasota, FL 34240

Sample Description: **One Poly Modified Micro Topping Sample**

Date Received: December 17, 2021


Test(s) Requested: WVTR - Water (ASTM E96/E96M)

PO Number: Credit Card

Analysis of One Poly Modified Micro Topping Sample

SGS-IPS Testing performed the testing listed above on one poly modified micro topping sample provided by Basecrete Technologies LLC. Please note, per customer agreement, the specimens were sanded down to create the required 3-inch circle specimens for testing. Results are summarized in Table 1 on the following pages of this report and in Chart 1 at the end of this report.

If you have any additional questions, please contact us.

Authorized by 
Jeffrey J. Bushner
Lab Manager


Signed 
Andrew Smits
Senior Lab Technician
Physical Testing
920-749-3040

Table 1. Physical Properties

Orientation	One Modified Micro Topping Sample	
	Top	Side B
Water Vapor Transmission - Water (ASTM E96/E96M)		
Area (m ²)	0.003166	NA
Weight Change/Time (g/hour)		
1	0.00327	NA
2	0.00589	NA
3	0.00679	NA
Average	0.00531	NA
Std. Dev.	0.001828	NA
Maximum	0.00679	NA
Minimum	0.00327	NA
n=	3	NA
WVTR (g/(h*m ²))		
1	1.0	NA
2	1.9	NA
3	2.1	NA
Average	1.7	NA
Std. Dev.	0.58	NA
Maximum	2.1	NA
Minimum	1.0	NA
n=	3	NA
WVTR (g/m ² /day)		
1	25	NA
2	45	NA
3	51	NA
Average	40	NA
Std. Dev.	13.9	NA
Maximum	51	NA
Minimum	25	NA
n=	3	NA
Vapor Pressure Difference (Pa)	1400	NA

Table 1. Physical Properties (contd.)

Orientation	One Modified Micro Topping Sample	
	Top	Side B
Permeance (g/(s*m ² *Pa))		
1	2.0E-7	NA
2	3.7E-7	NA
3	4.2E-7	NA
Average	3.3E-7	NA
Std. Dev.	1.14E-7	NA
Maximum	4.2E-7	NA
Minimum	2.0E-7	NA
n=	3	NA

Method(s) and Notes:

All valid results are included in the statistical analyses.

Revisions of SGS-IPS methods when used are current at the time of testing.

Sample(s) tested and conditioned in TAPPI standard conditions when conditioning is required by method, unless requested otherwise by customer, or otherwise specified.

Samples were not preconditioned.

ASTM E 96/E 96M - 16 Standard Test Methods for Water Vapor Transmission of Materials

Aluminum cups with O-ring seals were used.

The exposed surface area is 0.034 ft² (0.00316 m²).

Permeability has not been calculated.

Corrections for buoyancy and resistance due to Still Air and specimen surface were not done.

SGS-IPS always runs to an equilibrium slope and does not use a dummy cup as a proxy for equilibrium measurement.

Caliper was not performed.

Cups filled with 100ml of deionized water.

Parafilm was used to seal the edges during testing.

There was trouble removing the labels on the specimens for testing, there was some residual adhesive left on the specimens during testing.

Analyzed by: MAG

Quality review by: JVP

Date(s) of testing: December 31, 2021

Note: See the method(s) cited above for available estimates of measurement uncertainty.

Unless otherwise noted, sampling was performed by customer.

This document is issued by the Company with the expectation that the document will be used internally only and not be used for any marketing or any other public use and is subject to its General Conditions of Service printed overleaf, available on request or accessible at www.sgs.com/terms_and_conditions.htm and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at www.sgs.com/en/Terms-and-Conditions/terms-e-document.aspx. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Appendix A



Figure 1. Login Sample Photos One Modified Micro Topping Sample

WVTR at 23.1 °C and 49.3 %RH

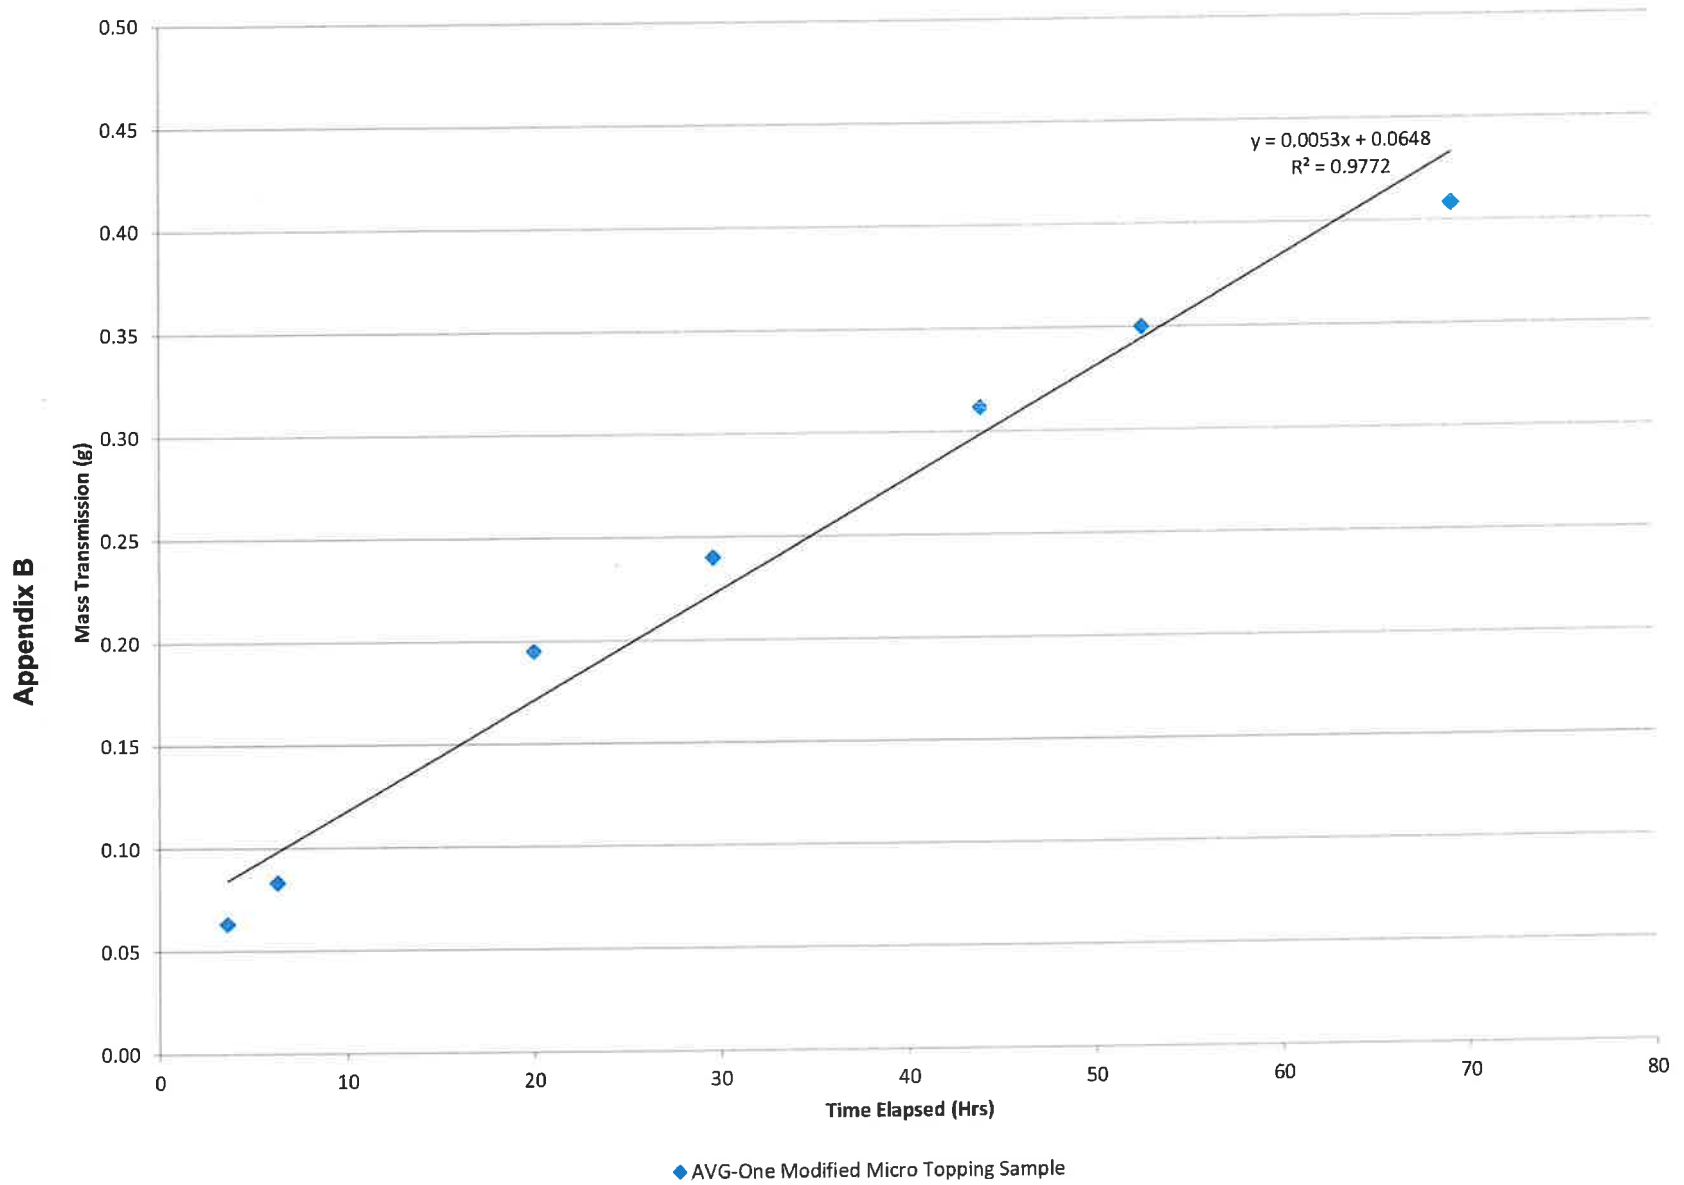


Chart 1