

www.assuredtesting.com
388 Servidea Drive
Ridgway, PA 15853 USA
P: +1 814-773-3224
F: +1 814-773-3225

Customer: Basecrete Technologies
Purchase Order# 855463
Quote #: 011922BCT
Primary Contact: Vito Mariano

BILL TO: FLSARASOT--2835
Basecrete Technologies
6148 Clark Center Ave
Sarasota FL 34238
USA
Ph: 941.879.4600

SENT TO: FLSARASOT--2835
Basecrete Technologies
6148 Clark Center Ave
Sarasota FL 34238
USA
Ph: 941.879.4600

TEST REPORT - 32410

Entry Date: Friday, January 28, 2022

*Pull Off Adhesion IAW ASTM D4541 (2017), Method E, Type 4.
Base layer is black, middle layer is gray and top layer is blue.*


See attached photos.

Part and Test Information

<h3>Test Result</h3> <p>Results: See below.</p> <p>Sample 1:</p> <ol style="list-style-type: none"> 511 psi - 100% topcoat removal with cohesive gray 669 psi - 100% topcoat removal with cohesive gray 793 psi - 100% topcoat removal with slight cohesive gray <p>Sample 2:</p> <ol style="list-style-type: none"> 592 psi - 100% topcoat removal with cohesive gray 649 psi - 100% topcoat removal with cohesive gray 482 psi - 100% topcoat removal with slight cohesive gray <p>Requirements: No pass / fail criteria provided. Report results and psi.</p>	Test Name/Procedure Adhesion ASTM D4541-17 Method E Pull-off Strength								
	Requirement Specification Unspecified								
	Customer Material Specification								
	Part Number								
	Lot Number								
	Sample Description 9.5" x 16" cement samples								
	In Date 03-Feb-22								
	Out Date 04-Feb-22								
	Test Count 2								
	Return Count 2								
	<table border="1"> <tr> <th>Cycles</th> <th>Hours</th> </tr> <tr> <td>Required</td> <td>Required</td> </tr> <tr> <td>Hours/Cycle</td> <td>Completed</td> </tr> <tr> <td>Completed</td> <td></td> </tr> </table>	Cycles	Hours	Required	Required	Hours/Cycle	Completed	Completed	
	Cycles	Hours							
	Required	Required							
Hours/Cycle	Completed								
Completed									

Michele Singer

Assistant Laboratory Manager




Issue Date: 2/10/2022

End Of Report

Test results apply only to the item(s) as received and as tested. If Assured Testing Services needs to manipulate a test item dimensionally for the purpose of equipment parameters the results only apply to the portion that is tested. When Information supplied by the customer could affect test results, the customer is responsible for the determining validity of the reported results. Information and statements in this report are derived from material, information, and/or specifications furnished by the client and exclude any expressed or implied warranties as to the fitness of material tested or analyzed for any particular purpose or use. This report is confidential property of our client and may not be used for advertising purposes. This report shall not be reproduced except in full, without written approval of this laboratory. This recording of false, fictitious or fraudulent statements or entries on this document may be punished as a felony. Sample remnants are retained for a minimum of 6 months following issuance of test results, at which point they will be discarded unless notified in writing by the client. Any client claims or damages arising from the use of information in this report are strictly limited to the cost of the services provided by Assured Testing Services.

Revision: 8/6/2019

Assured Testing Services, Ridgway, PA
TR32410 Basecrete Technologies
Photos of 9.5" x 16" Samples tested for Pull Off Adhesion
IAW ASTM D4541-17 Method E Type 4

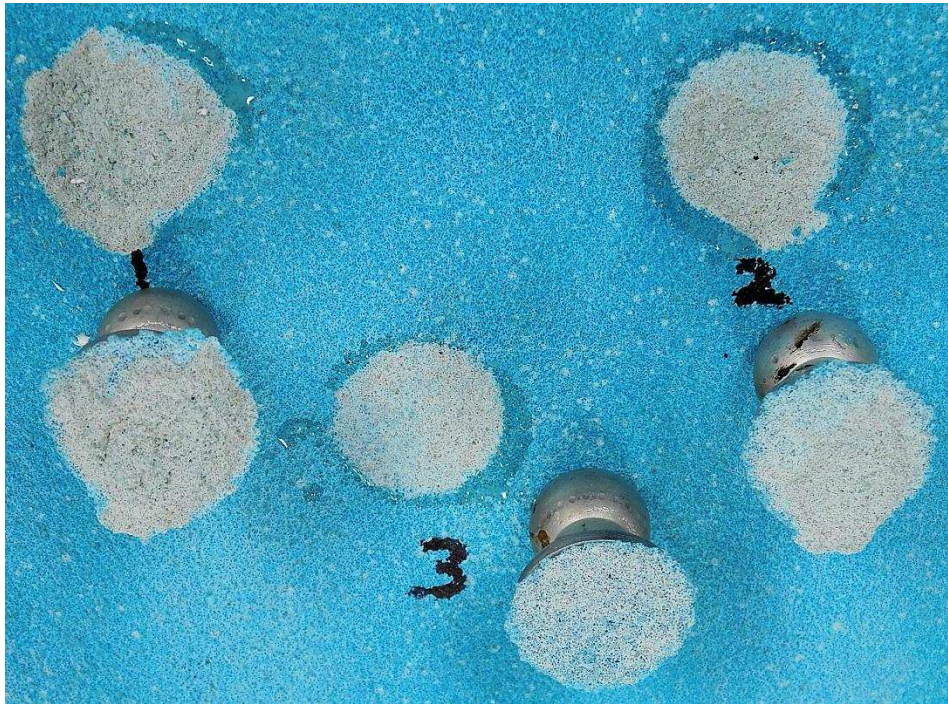

Sample 1: Three individual completed tests with corresponding dollies after pull-off adhesion – (See above)



Sample 2: Three individual completed tests with corresponding dollies after pull-off adhesion – (See above)

End of Photo Page